

SPECIFICATION FOR APPROVAL

Customer	STD					
${ m Description.}_{_}$	DC FAN					
Part No			_ REV			
Delta Model	No. ASB0	312HA-D	F00_	REV.	00	
Sample Issue	No					
Sample Issue						
PLEASE SE	END ONE C	OPY OF T	THIS SPE	CIFICAT	TION BACK	
AFTER YOU	U SIGNED A	APPROVAL	FOR PR	ODUCTI	ION PRE-	
ARRANGME	NT.					
APPROVED	BY:					
DATE	:					

Delta Electronics, Inc. HeTianXia High-Tech Industrial Park. Shi Jie Town, Dong Guan City. Guangdong Province, China. P. R. C.

TEL: 86-769-86329008 FAX: 86-769-86631589 Delta Electronics, Inc. HeTianXia High-Tech Industrial Park. Shi Jie Town, Dong Guan City. Guangdong Province, China. P. R. C.

TEL: 86-769-86329008 FAX: 86-769-86631589

NONE		
DESCRIPTION:		

Delta Electronics, Inc. HeTianXia High-Tech Industrial Park. Shi Jie Town, Dong Guan City. Guangdong Province, China. P. R. C.

SPECIFICATION FOR APPROVAL

TEL: 86-769-86329008

FAX: 86-769-86631589

Customer: STD

Description: DC FAN

Customer P/N: REV:

Delta Model NO.: ASB0312HA-DF00 Safety Model:

Sample Rev: 00 Issue NO:

Sample Issue Date: Quantity:

1. SCOPE:

THIS SPECIFICATION DEFINES THE ELECTRICAL AND MECHANICAL CHARACTERISTICS OF THE DC BRUSHLESS AXIAL FLOW FAN.

2. CHARACTERS:

ALL CHARACTERS ARE MEASURED UNDER THE STANDARD ENVIRONMENTAL CONDITION (25°C AND 1 ATM).

ITEM	DESCRIPTION		
RATED VOLTAGE	12 VDC		
OPERATION VOLTAGE	7.0 - 13.2 VDC		
MINIMUM START VOLTAGE	7.0 VDC		
INPUT CURRENT	0.07 (MAX. 0.14) A SAFETY CURRENT ON LABEL: 0.14 A		
INPUT POWER	0.84 (MAX. 1.68) W		
SPEED	10500±15% R.P.M.		
MAX. AIR FLOW (AT ZERO STATIC PRESSURE)	0.122 (MIN. 0.100) M 3 / MIN. 4.30 (MIN. 3.52) CFM		
MAX. AIR PRESSURE (AT ZERO AIRFLOW)	$5.44~(\mathrm{MIN.~3.65})~\mathrm{mmH_20} \\ 0.214~(\mathrm{MIN.~0.143})~\mathrm{inchH_20}$		
ACOUSTICAL NOISE (AVG.)	27.0 (MAX. 32.0) dB-A		
INSULATION TYPE	UL: CLASS A		


(continued)

page: 1

DELTA MODEL: ASB0312HA-DF00

10 MEG OHM MIN. AT 500 VDC (BETWEEN FRAME AND (+) TERMINAL)		
5 mA MAX. AT 500 VAC 50/60 Hz ONE MINUTE, (BETWEEN FRAME AND (+) TERMINAL)		
OPEN TYPE		
20,000 HOURS CONTINUOUS OPERATION AT 40°C WITH 65 %RH.		
COUNTERCLOCKWISE DIRECTION FROM FRONT VIEW OF AIR FLOW INLET		
UL: CLASS A		
UL 1061 AWG #28 BLACK WIRE NEGATIVE(-) RED WIRE POSITIVE(+) BLUE WIRE FREQUENCY(-F00)		

- NOTES: 1. ALL READINGS ARE MEASURED AFTER STABLY WARMING UP THROUGH 10 MINUTES.
 - 2. STANDARD AIR PROPERTY IS AIR AT (Td) 25°C TEMPERATURE, (RH) 65% RELATIVE HUMIDITY, AND (Pb) 760 mmHg BAROMETRIC PRESSURE.
 - 3. THE VALUES WRITTEN IN PARENS, (), ARE LIMITED SPEC.
 - 4. ACOUSTICAL NOISE MEASURING CONDITION:

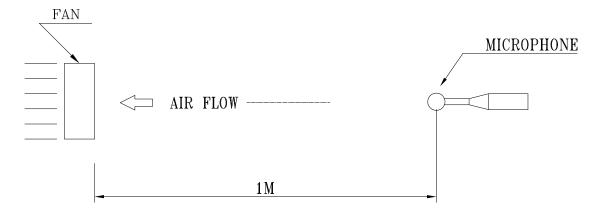

NOISE IS MEASURED AT RATED VOLTAGE IN FREE AIR IN SEMI-ANECHOIC CHAMBER WITH B & K SOUND LEVEL METER WITH MICROPHONE AT A DISTANCE OF ONE METER FROM THE FAN INTAKE.

DELTA MODEL: ASB0312HA-DF00

3. MECHANICAL:

- 3-3. IMPELLER PLASTIC UL: 94V-0
- 3-5. WEIGHT 7.4(REF.) GRAMS

4. ENVIRONMENTAL:

- 4-1. OPERATING TEMPERATURE -10 TO +70 DEGREE C
- 4-2. STORAGE TEMPERATURE -40 TO +75 DEGREE C
- 4-3. OPERATING HUMIDITY 5 TO 90 % RH
- 4-4. STORAGE HUMIDITY 5 TO 95 % RH

5. PROTECTION:

5-1. LOCKED ROTOR PROTECTION

IMPEDANCE OF MOTOR WINDING PROTECTS MOTOR FROM FIRE IN 96 HOURS OF LOCKED ROTOR CONDITION AT THE RATED VOLTAGE.

5-2. POLARITY PROTECTION

BE CAPABLE OF WITHSTANDING IF REVERSE CONNECTION FOR POSITIVE AND NEGATIVE LEADS.

6. RE OZONE DEPLETING SUBSTANCES:


6-1. NO CONTAINING PBBs, PBBos, CFCs, PBBEs, PBDPEs AND HCFCs.

7. PRODUCTION LOCATION

7-1. PRODUCTS WILL BE PRODUCED IN CHINA OR THAILAND.

DELTA MODEL: ASB0312HA-DF00

8. P & Q CURVE:

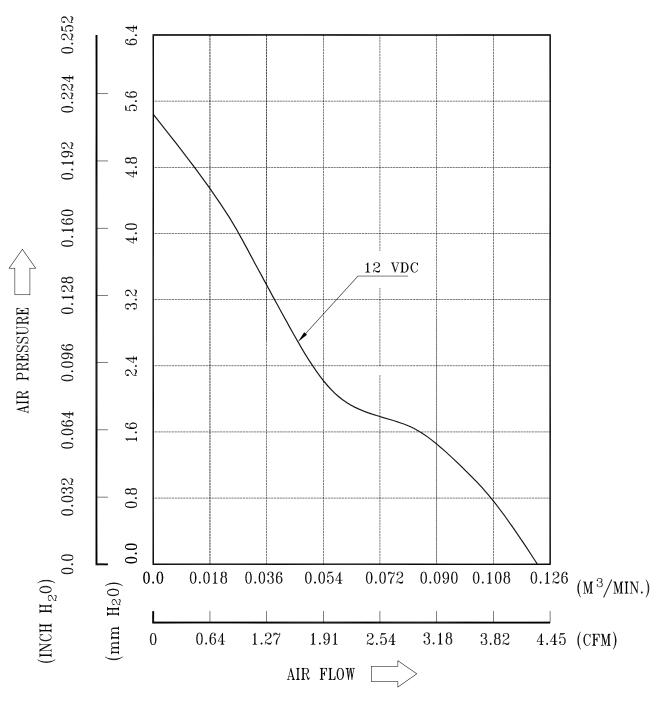

* TEST CONDITION: INPUT VOLTAGE — OPERATION VOLTAGE TEMPERATURE — ROOM TEMPERATURE HUMIDITY — 65%RH


page: 4

A00

DELTA MODEL: ASB0312HA-DF00

9. DIMENSION DRAWING:



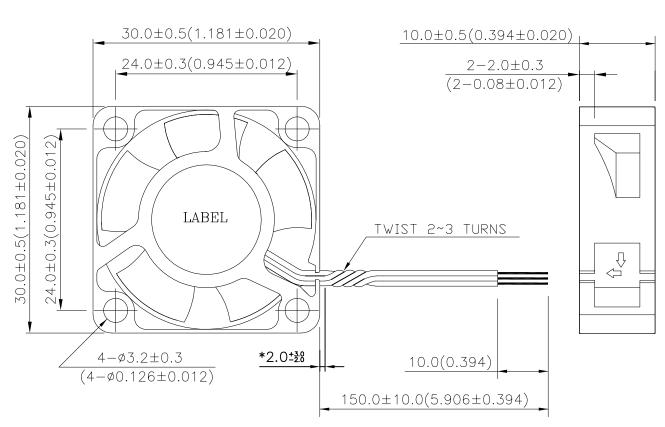

UNIT: mm(INCH)


- 1. THIS PRODUCT IS ROHS COMPLIANT
- 2. UL 1061 -F- AWG #28
 BLACK WIRE NEGATIVE(-)
 RED WIRE POSITIVE(+)
 BLUE WIRE FREQUENCY(-F00)


page: 5

A00

DELTA MODEL: ASB0312HA-DF00

10. FERUENCY GENERATOR (FG) SIGNAL:



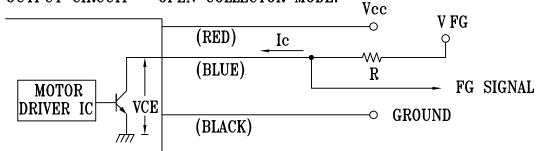

CAUTION: THE FG SIGNAL LEAD WIRE MUST BE KEPT AWAY FROM "+" LEAD WIRE & "-" LEAD WIRE.

2. SPECIFICATION:


 V_{CE} (sat)=0.5V MAX.

 $V_{FG} = 13.2 \text{VDC MAX}.$


 $I_c = 5mA MAX.$

 $R \ge V_{FG} / I_{C}$

3. FREQUENCY GENERATOR WAVEFORM:

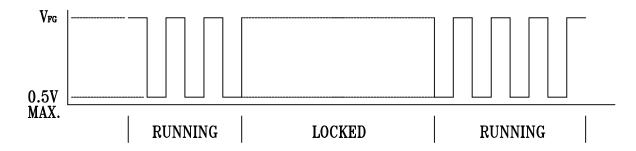

FAN RUNNING FOR 4 POLES

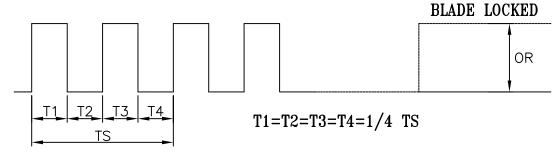

N=R.P.M

TS=60/N(SEC)

*VOLTAGE LEVEL AFTER BLADE LOCKED

*4 POLES

page: 6

A00



Application Notice

- 1. Delta will not guarantee the performance of the products if the application condition falls outside the parameters set forth in the specification.
- 2. A written request should be submitted to Delta prior to approval if deviation from this specification is required.
- 3. Please exercise caution when handling fans. Damage may be caused when pressure is applied to the impeller, if the fans are handled by the lead wires, or if the fan was hard-dropped to the production floor.
- 4. Except as pertains to some special designs, there is no guarantee that the products will be free from any such safety problems or failures as caused by the introduction of powder, droplets of water or encroachment of insect into the hub.
- 5. The above-mentioned conditions are representative of some unique examples and viewed as the first point of reference prior to all other information.
- 6. It is very important to establish the correct polarity before connecting the fan to the power source. Positive (+) and Negative (-). Damage may be caused to the fans if connection is with reverse polarity, if there is no foolproof method to protect against such error specifically mentioned in this spec.
- 7. Delta fans without special protection are not suitable where any corrosive fluids are introduced to their environment.
- 8. Please ensure all fans are stored according to the storage temperature limits specified. Do not store fans in a high humidity environment. We highly recommend performance testing is conducted before shipping, if the fans have been stored over 6 months.
- 9. Not all fans are provided with the Lock Rotor Protection feature. If you impair the rotation of the impeller for the fans that do not have this function, the performance of those fans will lead to failure.
- 10. Please be cautious when mounting the fan. Incorrect mounting of fans may cause excess resonance, vibration and subsequent noise.
- 11. It is important to consider safety when testing the fans. A suitable fan guard should be fitted to the fan to guard against any potential for personal injury.
- 12. Except where specifically stated, all tests are carried out at room (ambient) temperature and relative humidity conditions of 25°C, 65% RH. The test value is only for fan performance itself.
- 13. Be certain to connect an "4.7μF or greater" capacitor to the fan externally when the application calls for using multiple fans in parallel, to avoid any unstable power.

Doc. No: FMBG-ES Form 001 Rev. 0001 Date: June 24, 2009